



Karnataka Fire and Emergency Services Department

Office of the District fire officer,
Jnanabharathi fire station
Bangalore University Premisess, Bangalore – 560 056.
Ph No.080 – 22971614



No.81/CC/DFO/JBFS/2025.

Date:-08-09-2025.

TO,

The Principal,
M/s K.L.E Society's School
U-DISE No: - 29284100065
2nd stage, 3rd Block,
Nagarabhavi,
Bangalore -560072

Sir,


Sub: Issues of "Compliance Certificate" with respect to fire prevention, fire fighting and evacuation measures complied and maintained at M/s. KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072

Ref: 1.FSR No.81/FSR/DFO/JBFS/2025, Date: 05-09-2025
3.Your letter dated : 08-09-2025

* * * * *

With reference to subject above cited, 'Fire Safety Recommendation' was issued wide reference (1) to the premises M/s. KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072, with an condition to fulfill the recommendations and compliance the same within 3 months.

As per reference cited (2) above The management of M/s. KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072 had requested for the Fire Safety Compliance Certificate from our department .



The above mentioned educational building was inspected me on 08-09-2025 for issuing Compliance Certificate the management of M/s. *KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072* was complied the all recommendation communicated in Fire Safety Recommendation.

Under the above circumstances the Karnataka Fire & Emergency Services Department is Issues the 'Fire Safety Compliance Certificate' M/s. *KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072* Subject to Proper maintenance of fire fighting installations is good working conditions and to arrange basic fire fighting training for employees at our R.A.Mundkur Fire & Emergency service academy, Bangalore and to renewal the compliance report for every two year.

This Fire Safety Compliance Certificate is valid till dated 07-09-2027 and it is renewable.

Yours faithfully.


District Fire Officer
Jnanabharathi Fire Station
Bengaluru - 560 056

Karnataka Fire and Emergency Services Department



Office of the District fire officer,

Jnanabharathi fire station

Bangalore University Premises, Bangalore – 560 056.

Ph No.080 – 22971614



No.81/FSR/DF0/JBFS/2025.

Date:- 05-09-2025.

To,

*The Principal,
M/s K.L.E Society's School
2nd stage, 3rd Block,
Nagarabhavi,
Bangalore -560072*

Sir,

Sub: Issue of **Fire Safety Recommendation** with respect of Fire prevention fire fighting and evacuation measures required at **M/s KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072**

Ref: 1) Your letter dated: 05-09-2025

ANNEXURE-B


NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2.

(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory)


With reference to the subject cited above the premises of **M/s KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072** was inspected by me on 05-09-2025 with respect to Fire prevention, Fire fighting and Evacuation measures to be complied in the above premises and has submitted the details as under.

A. Details of the building / premises :-

01	Name and Address of the Applicant.	:	The Principal M/s <i>KLE Society's School</i> 2 nd stage, 3 rd Block, Nagarabhavi, Bangalore -560072
----	------------------------------------	---	--

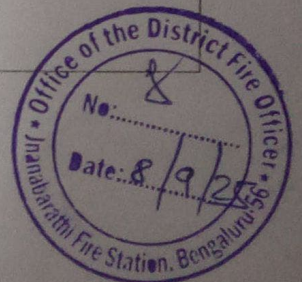


02	Name and Address of the premises.	:	M/s <i>KLE Society's School</i> 2 nd stage, 3 rd Block, Nagarabhavi, Bangalore -560072
03	Name and address of the Building owner	:	KLE Secretary M/s <i>KLE Society, Belgaum</i>
04	Number of buildings	:	One Building
05	Number of floors	:	
06	<u>Floor-wise details of occupancy:-</u>		
	Basement	:	Vehicle Parking Area
	Ground floor	:	13 Class room, 01 book room, 02 Office room, 01 Lab, 01 Store
	1 st floor	:	07 Class room, 2 staff room, 01 Dance room, 04 Lab,
	2 nd floor	:	14 Class room, 01 Staff room, 01 Yaoga
	3 rd floor	:	13 Class room, 01 drawing room, 01 office room, 01 Lab
07	Height of the buildings:-	:	14.50 Mtrs,
08	Site area	:	05 Acre.
09.	Built-up area of each floor:-		
	Basement	:	2251.07 Sq.mtrs
	Ground floor	:	2251.07 Sq.mtrs.
	1 st floor	:	2251.07 Sq.mtrs.
	2 nd floor	:	2251.07 Sq.mtrs.
	3 rd floor	:	2251.07 Sq.mtrs.
10.	Total built-up area	:	11.255.35 .Sq.mtrs.
11.	Surrounding properties:-		
	East (Front)	:	08.00 mtrs wide road
	West (Rear)	:	PU College building
	North (Side)	:	Degree College
	South (Side)	:	BWSSB Water tank
12.	<u>Set-back area available around the building :-</u>		
	East (Front)	:	08.00 mtrs
	West (Rear)	:	Nil
	North (Side)	:	Nil
	South (Side)	:	06.00 mtrs




Allowed setbacks (Open space) Should be maintained free from further obstruction/construction

B. On inspection of this School/Collage premises, the following fire prevention, fire fighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-


Sl. No.(1)	Details (02)	Existing (03)	Recommendations (04)																					
1.	Accessibility to the premises	The premises are accessible from 08.00 mtr wide road located on Eastern side.	Adequate.																					
2.	No. of entrances	01 Entrances with entry & Exit.	Adequate.																					
3.	Width of entry / exit	05.00 mtrs width of 05.00 mtrs width has been provided	Adequate.																					
4.	Diesel Generator	One Generator of 65 KVA Capacity has been provided.	Complied																					
5.	Number of staircases available	<table border="1"> <tr> <td>Nos. of staircases</td> <td>:</td> <td>01</td> </tr> <tr> <td>Width of staircases</td> <td>:</td> <td>1.80 mtrs</td> </tr> <tr> <td>Width of treads</td> <td>:</td> <td>30 Cm</td> </tr> <tr> <td>Height of risers</td> <td>:</td> <td>15 Cm.</td> </tr> <tr> <td>Nos. of riser per flight</td> <td>:</td> <td>11 No's</td> </tr> <tr> <td>Height of handrails</td> <td>:</td> <td>01.20 mtrs</td> </tr> <tr> <td>Head room clearance</td> <td>:</td> <td>03.00 Mtrs</td> </tr> </table>	Nos. of staircases	:	01	Width of staircases	:	1.80 mtrs	Width of treads	:	30 Cm	Height of risers	:	15 Cm.	Nos. of riser per flight	:	11 No's	Height of handrails	:	01.20 mtrs	Head room clearance	:	03.00 Mtrs	Complied
Nos. of staircases	:	01																						
Width of staircases	:	1.80 mtrs																						
Width of treads	:	30 Cm																						
Height of risers	:	15 Cm.																						
Nos. of riser per flight	:	11 No's																						
Height of handrails	:	01.20 mtrs																						
Head room clearance	:	03.00 Mtrs																						
6.	Portable Fire extinguisher	<p>Basement Floor 20 nors ABC Fire extinguishers 5kg capacity have been Provided.</p> <p>Ground Floor 20 nors ABC Fire extinguishers 5kg capacity have been</p>	Complied																					



		<p>Provided.</p> <p>First Floor 20 nos ABC Fire extinguishers 5kg capacity have been Provided.</p> <p>Second Floor 20 nos ABC Fire extinguishers 5kg capacity have been Provided.</p> <p>Third Floor 12 nos ABC Fire extinguishers 5kg capacity have been Provided.</p> <p>One mechanical foam extinguisher of 9 ltrs capacity & One ABC type extinguisher of 6 kgs capacity have been provided near diesel generator.</p> <p>One CO2 type fire extinguisher, of 4.5 kgs capacity has been provided near each electrical panel board & electrical room.</p>	
7.	First aid Hose reel hose.	Hose Reel Hose system have been provided near the staircases. Each hose reel hose of min 19mm size and of adequate length to reach the farthest point of each floor have been provided shut off branch having a nozzle of 5mm size. The hose reel hose have been connected at each landing.	Complied
8.	Terrace Pump at the terrace tank level with minimum pressure of 3.5 kg/cm ² .	Each Hose reel hose system Have been connected to an Booster pump capable of delivering 450 LPM (Further the system should be connected to an alternative source of power supply)	Complied
9.	Terrace tank over respective	Each Hose reel hose system Have been connected to an over	Complied

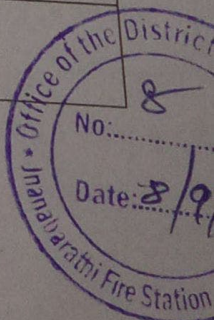

	lower terrace.	head tank of 10,000 ltrs capacity. (The water tank should be kept exclusively for firefighting).	
10.	Public address system	Public address system with 2 way communication facility near the staircase landing with its console at the control room, located on the ground floor of Building should be provided.	Complied
11.	Escape routes	Escape routes and fire exits boards have been displayed at corridors or passages and appropriate places of the building to guide the students and staff to safer places during emergency or fire.	Displayed.
12.	Fire order (fire safety Plans)	A notice board indicating the details of actions to be taken in case of emergency should be displayed near each staircase landings with the telephone numbers of our Jnanabharathi Fire Station. 080-22971614 or 101 or 112, and telephone numbers of nearest Ambulance Service.	Complied
13.	No Smoking board	COTPA Sec-4 direction No smoking area, Smoking is an offence board should be written in English and kannada both language shall be prominently displayed at inside the entry/exit of each floor.	Complied
14.	Fire siren	A fire siren shall be installed in the premises to inform the inmates in the case of a fire emergency and evacuate the area.	Complied

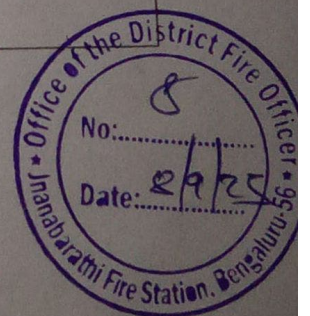

15.	Fire fighting training	Not yet trained	At least 40% of Teaching and non teaching staff should be got trained basic fire fighting at R.A. Mundkur Fire and Emergency Services Academy, Bannerughatta road, Bangalore.
-----	------------------------	-----------------	---

Fire precautionary measures :-


- A. Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory & electrical sum panel premises.
- B. Accumulation of combustibile waste in and around the premises should be avoided.
- C. The exit ways shall be always kept clear without any obstruction.
- D. Liquefied petroleum gas should not be stored in the building.
- E. The doors shall not be kept locked / latched during working hours and shall be free from obstruction.
- F. During the class hours the class room doors shall not be locked from inside to outside.
- G. As per Hon'ble Supreme Court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordinate with fire service department.


Under the above circumstance the Karnataka Fire & Emergency Service Department is Issue of 'Fire Safety Recommendation' to M/s KLE Society's School, 2nd stage, 3rd Block, Nagarabhavi, Bangalore -560072 subject to condition and compliance of the above recommendations in column-4 of serial-B within 3 months and compliance to the undersigned.

This 'Fire Safety Recommendation' is issued for a period of only one year from the date of issue.

* All requirements recommended above are as per National Building Code- 2016 Part-4 clause 3.1.3 of Fire and Life safety will have to be complied with mandatorilly.

Yours faithfully,


District Fire Officer
Jnanabharathi Fire Station
Bengaluru - 560 056



ಚಲನ್ ಚಾಲ್ತಿ ಅವಧಿ Challan Validity	ಜಿಲ್ಲೆ District	ಇಲಾಖೆ Department	ಡಿಡಿಓ ಕಛೇರಿ DDO Office	
7 Days	BENGALURU URBAN	DEPARTMENT OF KARNATAKA FIRE & EMERGENCY SERVICES	DIVISIONAL FIRE OFFICE, BANGALORE WEST RANGE, KARNATAKA FIRE AND EMERGENCY SERVICES, BANGALORE	
ವರ್ಗ Category	ದಿನಾಂಕ Date	ಚಲನ್ ಉಲ್ಲೇಖ ಸಂಖ್ಯೆ Challan Reference Number	ಡಿಡಿಓ ಕೋಡ್ DDO Code	
Government	05/09/2025 19:53:00	CR0925007000092555	140030	
ಸಂದಾಯದಾರನ ಹೆಸರು Remitter Name	THEPRINCIPLE KLE SOCIETYSCHOOL	ಮೊಬೈಲ್ ಸಂಖ್ಯೆ Mobile Number	7975667409	
ವಿಳಾಸ Address	NAGARABHAVI 2ND STAGE, 2ND BLOCK, BANGALORE			
ಉದ್ದೇಶ Purpose	ಲೆಕ್ಕ ಶೀರ್ಷಿಕೆ Head of Account	ಉಪ ಉದ್ದೇಶದ ಹೆಸರು Sub Purpose Name	ಉದ್ದೇಶ ನಿರ್ದೇಷ್ಟ ಐಡಿ Purpose Specific ID	ಮೊತ್ತ Amount
COLLECTION OF FEES AND OTHER RECEIPTS FROM FIRE DEPARTMENT	0070~60~109~0~02~000	12.FOR ISSUE OF ADVISE ON FIRE PREVENTION AND FIRE FIGHTING FOR NON HIGH RISE BUILDINGS.	NA :	22000.00
ಸಂದಾಯ ಮಾಡುವ ಬ್ಯಾಂಕ್ Remittance Bank	State Bank of India e Pay	ಒಟ್ಟು ಮೊತ್ತ Grand Total		22000.00
		ಒಟ್ಟು ಮೊತ್ತ ಅಕ್ಷರಗಳಲ್ಲಿ Total Amount in Words		Twenty Two Thousand Only
ಪಾವತಿ ವಿವರಗಳು\Payment Details				
ಪಾವತಿ ವಿಧ Payment Mode	Netbanking			

*ನಿಮ್ಮ ವಹಿವಾಟನ್ನು ಸಂಸ್ಕರಿಸಲಾಗಿದೆ. ಮುಂದಿನ ಉಲ್ಲೇಖಕ್ಕಾಗಿ ದಯವಿಟ್ಟು ವಹಿವಾಟು ಸಂಖ್ಯೆಯನ್ನು ಬರೆದಿಟ್ಟುಕೊಳ್ಳಿ. ವಹಿವಾಟು ಸಂಖ್ಯೆ
Your Transaction has been processed. Please note the Transaction number for future referenc
Transaction No. 0888528678817

*ಕ್ರೆಡಿಟ್ ಕಾರ್ಡ್/ಡೆಬಿಟ್ ಕಾರ್ಡ್ ಮೂಲಕ ಮಾಡಿರುವ ಎಲ್ಲಾ ಪಾವತಿಗಳ ಮೇಲೆ ಹೆಚ್ಚುವರಿ ಸೇವಾ ಶುಲ್ಕ ಅನ್ವಯವಾಗುತ್ತದೆ. ಹಾಗೂ ಬ್ಯಾಂಕ್ ಅದನ್ನು ನೇರವಾಗಿ ಖರ್ಚು ಹಾಕುತ್ತದೆ.
Additional Service charges are applicable for all payments made through CC/DC and the same would be debited directly by the bank.

*ಯಾವುದೇ ಸಂದರ್ಭದಲ್ಲಿ ಸಂದಾಯದಾರನು ಶುಲ್ಕ ಮರುಪಾವತಿಯನ್ನು ಕೊರಬಾರದು
Under no circumstances the remitter will seek a Charge Back

